

LINE TYPE LEGEND

- PROCESS LINE
- PNUEMATIC AIR LINE
- ENCLOSURE BOUNDRY
- ELECTRICAL SIGNAL

FITTINGS

- CAP
- REDUCER
- BLIND FLANGE
- NOZZLE
- FLANGED JOINT
- HOSE COUPLING
- MALE CONNECTION
- FEMALE CONNECTION

FLOW INSTRUMENTS

- FT 100
MASS FLOW METER
- FT 100
FLOW TRANSMITTER
- FI 100
ROTOMETER
- FI 100
FLOW INDICATOR

PROCESS ANAYLZERS

- AIT 200
- O3
OZONE MONITOR
- AIT 200
- O2
OXYGEN MONITOR
- AIT 200
- 3-CHANNEL
OZONE MONITOR
- AIT 100
DISSOLVED OZONE
MONITOR
- AIT 100
PH MONITOR
- AIT 100
ORP MONITOR

MEANING OF FUNCTIONAL INSTRUMENT IDENTIFICATION LETTERS					
FIRST LETTER			SUCCEEDING LETTERS		
	MEASURED OR INITIATING VARIABLE	MODIFIER	READOUT OR PASSIVE FUNCTION	OUTPUT FUNCTION	MODIFIER
A	ANALYSIS		ALARM		
B	BURNER FLAME		USER CHOICE	USER CHOICE	USER CHOICE
C	USER CHOICE			CONTROL	
D	USER CHOICE	DIFFERENTIAL			
E	VOLTAGE (EMF)		PRIMARY ELEMENT		
F	FLOW RATE	RATIO			
G	GAUGING (DIMENSIONAL)		GLASS		
H	HAND (MANUALLY INITIATED)				HIGH
I	CURRENT (ELECTRICAL)		INDICATE		
J	POWER	SCAN			
K	TIME OR TIME-SCHEDULE			CONTROL STATION	
L	LEVEL		LIGHT (PILOT)		LOW
M	MODULATING	MOMENTARY		MIDDLE OR INTERMEDIATE	
N	USER CHOICE		USER CHOICE	USER CHOICE	USER CHOICE
O	USER CHOICE		ORIFICE (RESTRICTION)		
P	PRESSURE OR VACUUM		POINT (TEST POINT)		
Q	QUANTITY OR EVENT	INTEGRATE OR TOTALIZE			
R	RADIATION		RECORD OR PRINT		
S	SPEED OR FREQUENCY	SAFETY		SWITCH	
T	TEMPERATURE			TRANSMIT	
U	MULTIVARIABLE		MULTIFUNCTION	MULTIFUNCTION	MULTIFUNCTION
V	VIBRATION OR MECHANICAL ANALYSIS			VALVE, DAMPER OR LOUVER	
W	WEIGHT OR FORCE		WELL		
X	UNCLASSIFIED		UNCLASSIFIED	UNCLASSIFIED	UNCLASSIFIED
Y	EVENT, STATE OR PRESENCE		RELAY OR COMPUTE		
				DRIVE, ACTUATE OR UNCLASSIFIED FINAL CONTROL ELEMENT	
Z	POSITION				

REFERENCE DESIGNATION LEGEND

REF-DES #	LINE USE
000-099	COMPRESSED AIR
100-199	OXYGEN SUPPLY
200-299	OZONE SUPPLY
300-399	COOLING WATER SUPPLY
400-499	COOLING WATER RETURN
500-599	CHILLER
600-699	INJECTION
700-799	OZONE DESTRUCT
800-899	ANAYLZERS
900-999	OZONE FLOW CONTROL


THIS DRAWING AND ALL INFORMATION CONTAINED HEREIN IS THE PROPERTY OF GUARDIAN MANUFACTURING, 2971-A OXBOW CIRCLE, COCOA, FL 32926. IT IS PROPRIETARY INFORMATION AND IT IS FURNISHED FOR THE EXPRESSLY RESTRICTED USE IN CONJUNCTION WITH THIS PROJECT AND SHALL NOT BE COPIED, REPRINTED OR DISCLOSED TO A THIRD PARTY EITHER WHOLLY OR IN PART WITHOUT THE PRIOR WRITTEN CONSENT OF GUARDIAN MANUFACTURING.



2971-A OXBOW CIRCLE - COCOA, FL 32926

		UNLESS OTHERWISE SPECIFIED:			NAME	DATE	TITLE: OZONE SYSTEM P&ID	
MATERIAL:	N/A	DIMENSIONS ARE IN INCHES TOLERANCES ARE: DECIMALS .X ± .1 .XX ± .02 .XXX ± .005			DRAWN BY:	EW	4/29/2021	
					REVIEWED BY:	EW	4/29/21	
NEXT ASSY	USED ON	FINISH: N/A		WORK ORDER:	REVIEWED BY:			
APPLICATION							SCALE: 1:1	WEIGHT:
								SHEET 1 OF 3

CONTROLLED

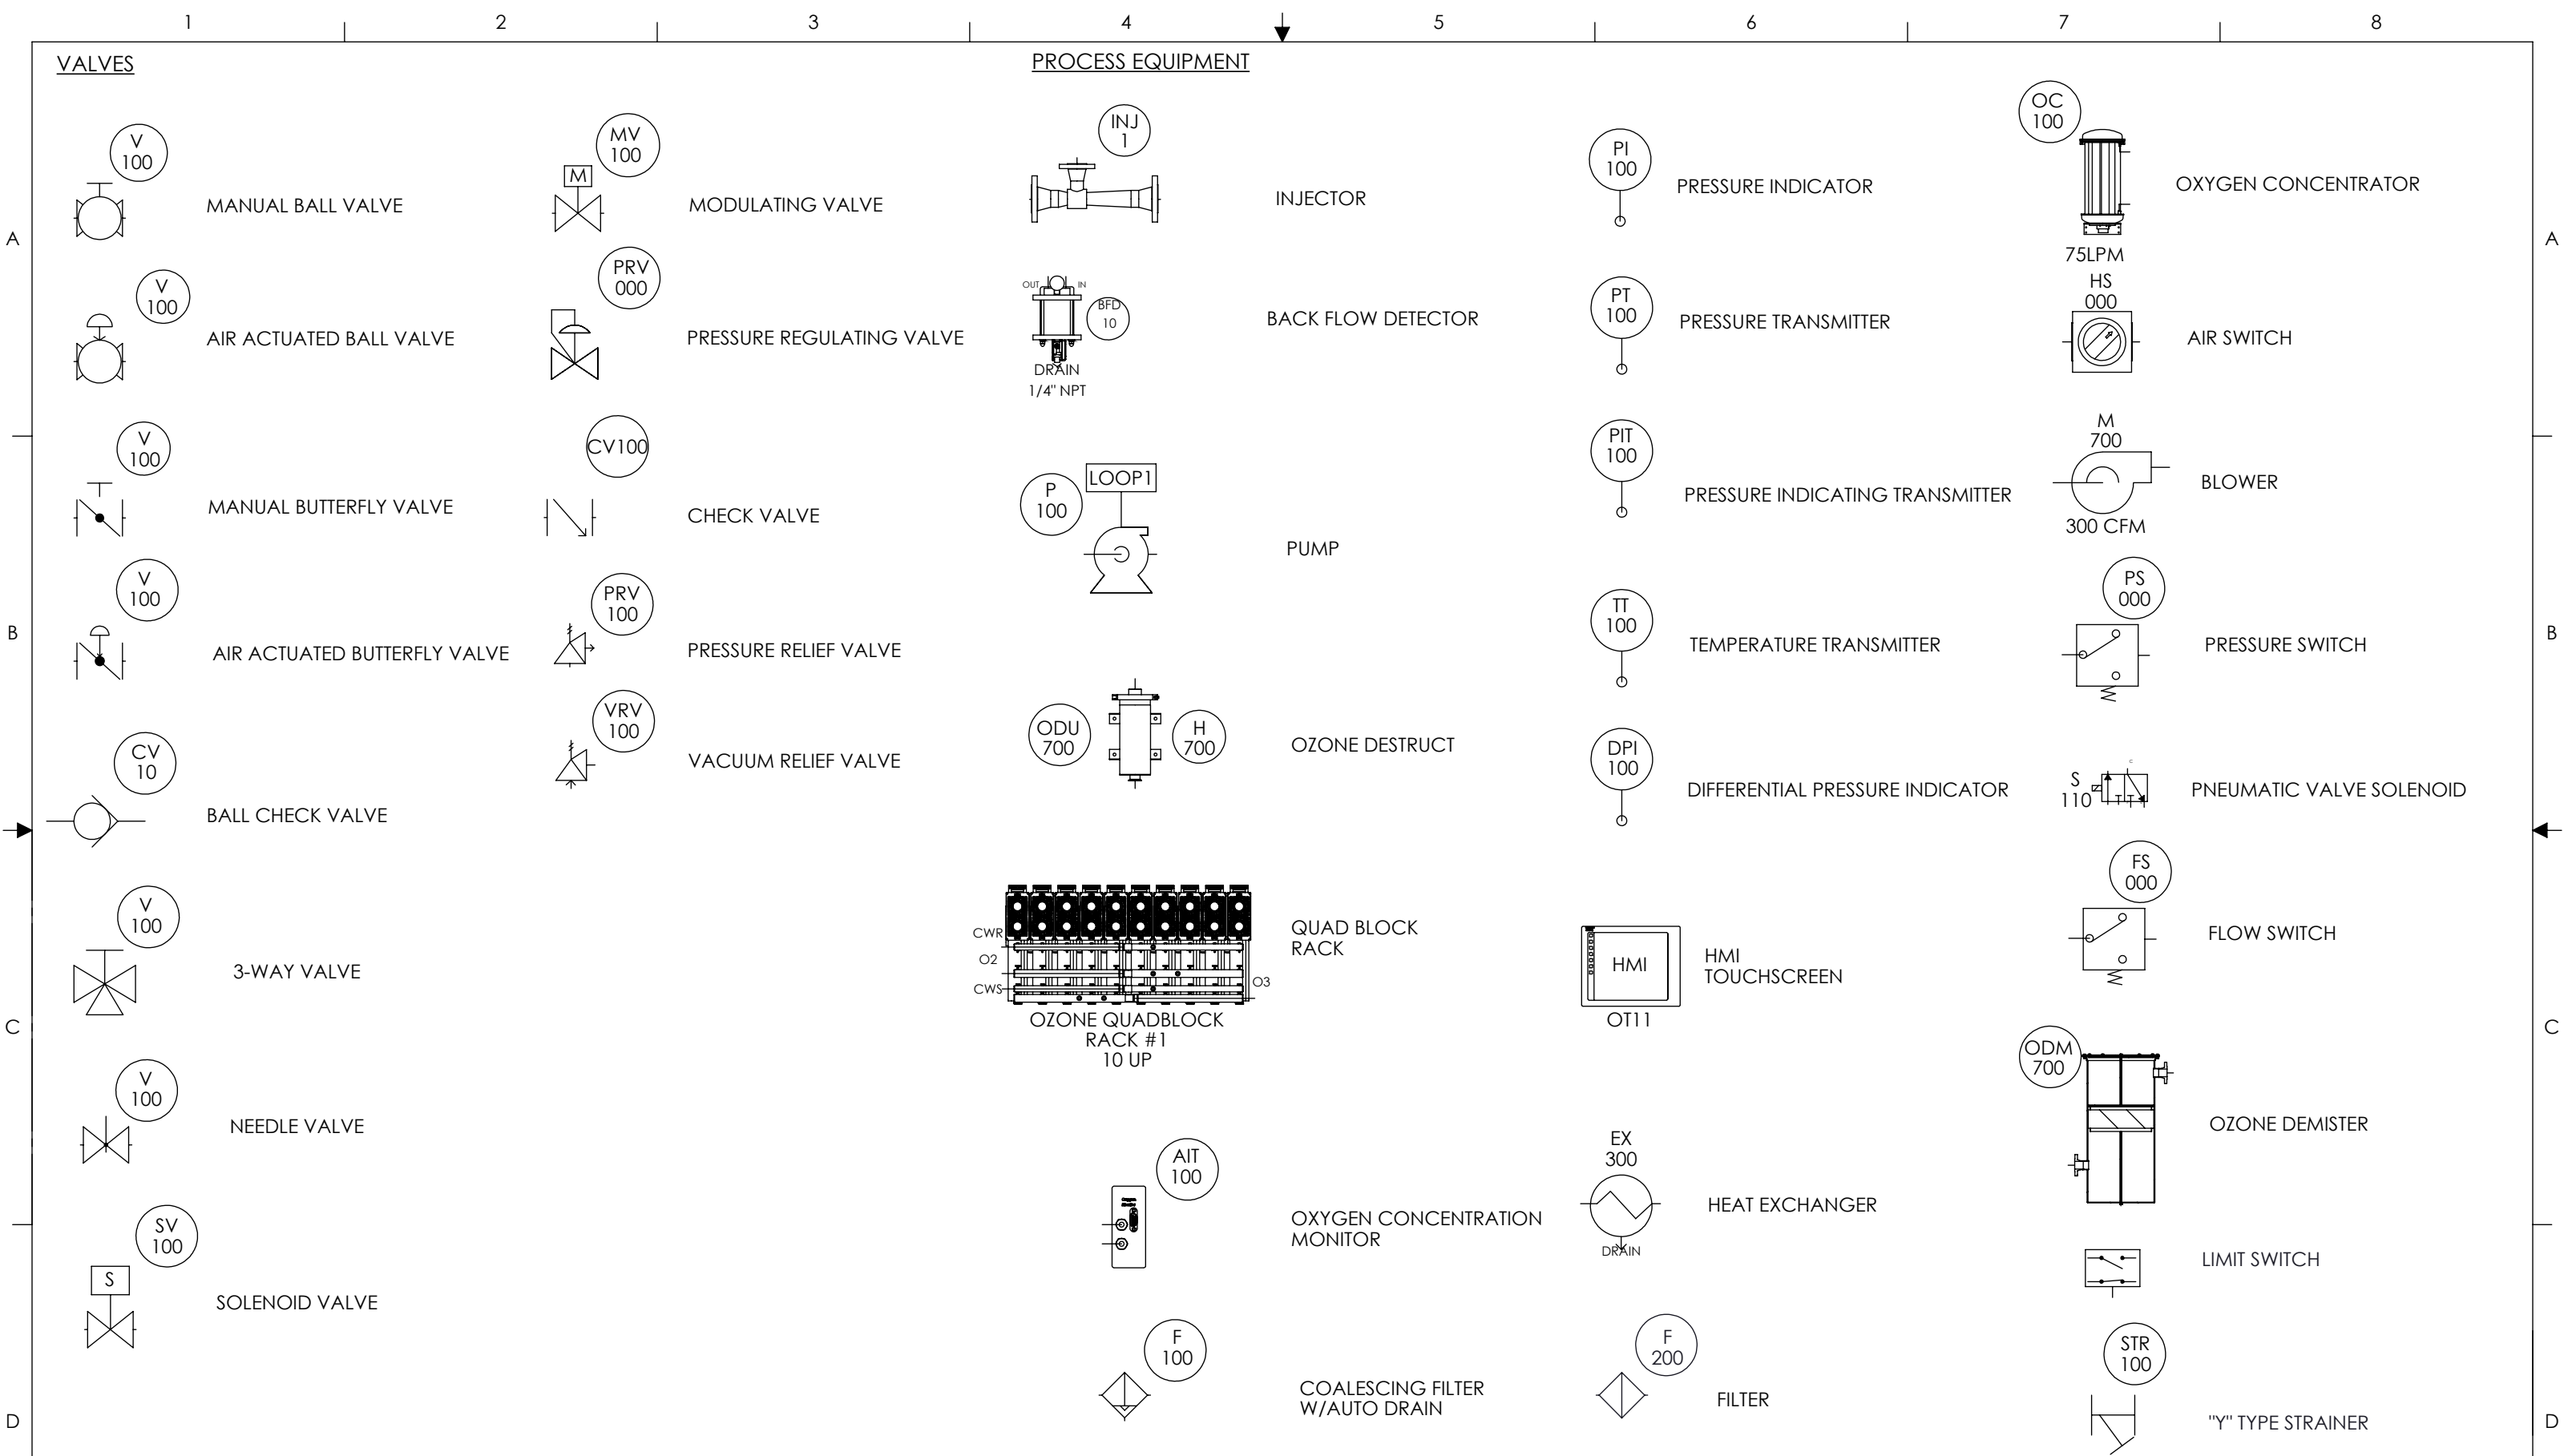

THIS DRAWING AND ALL INFORMATION CONTAINED HEREIN IS THE PROPERTY OF GUARDIAN MANUFACTURING, 2971-A OXBOW CIRCLE, COCOA, FL 32926. IT IS PROPRIETARY INFORMATION AND IT IS FURNISHED FOR THE EXPRESSLY RESTRICTED USE IN CONJUNCTION WITH THIS PROJECT AND SHALL NOT BE COPIED, REPRINTED OR DISCLOSED TO A THIRD PARTY EITHER WHOLLY OR IN PART WITHOUT THE PRIOR WRITTEN CONSENT OF GUARDIAN MANUFACTURING.		 2971-A OXBOW CIRCLE - COCOA, FL 32926		UNLESS OTHERWISE SPECIFIED:		NAME	DATE	TITLE:	
				MATERIAL:	DIMENSIONS ARE IN INCHES TOLERANCES ARE: DECIMALS .XX ± .1 .XXX ± .005				
				NEXT ASSY	USED ON	DRAWN BY:	EW	OZONE SYSTEM P&ID	
				APPLICATION		REVIEWED BY:	EW		
				FINISH:		WORK ORDER:		SIZE: B	REV A
								DWG. NO. 0740-0000-1	SHEET 2 OF 3
								SCALE: 1:1	WEIGHT:

